


WITHOUT FIRE SPRINKLERS

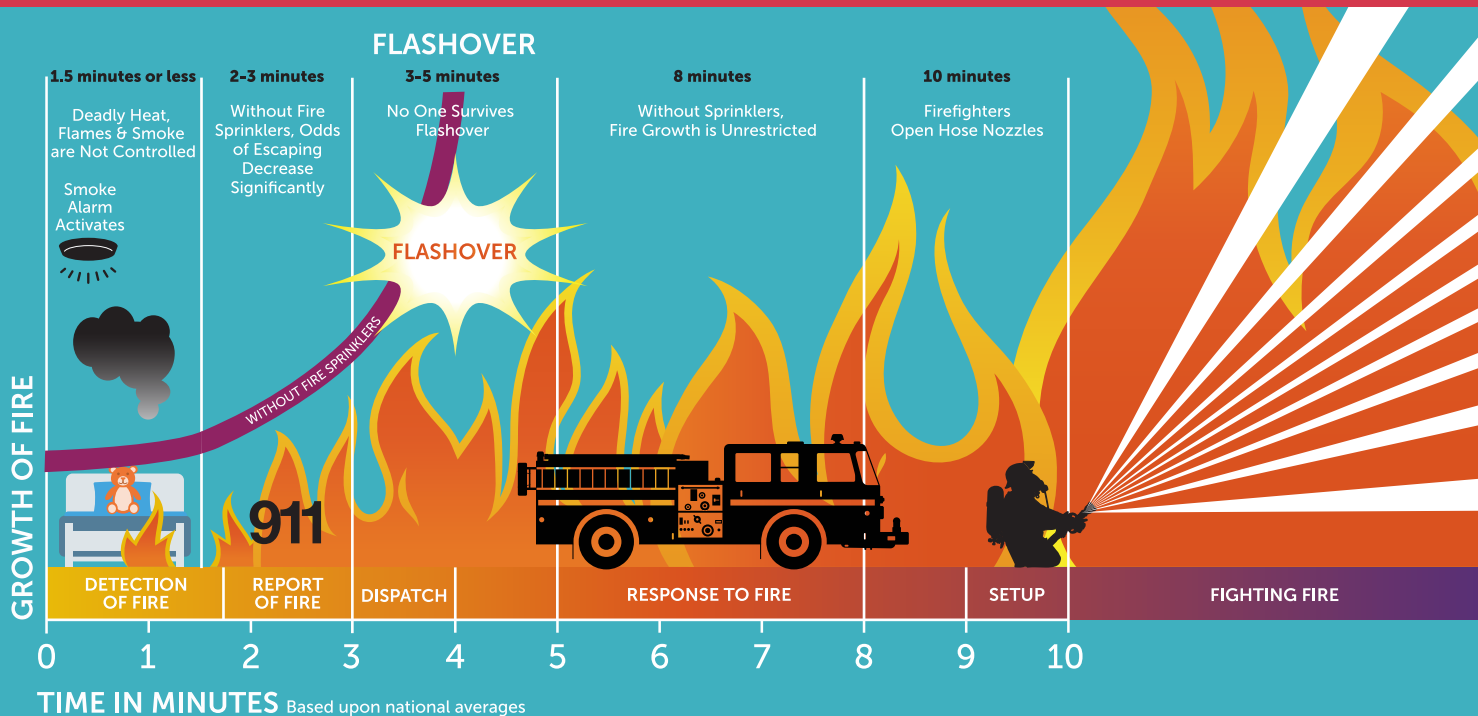

1.5 minutes or less

Deadly Heat, Flames & Smoke are Not Controlled

Smoke Alarm Activates



2-3 minutes

Without Fire Sprinklers, Odds of Escaping Decrease Significantly

911

DETECTION OF FIRE

REPORT OF FIRE

FLASHOVER

3-5 minutes

No One Survives Flashover

FLASHOVER

DISPATCH

8 minutes

Without Sprinklers, Fire Growth is Unrestricted

RESPONSE TO FIRE

10 minutes

Firefighters Open Hose Nozzles

SETUP

FIGHTING FIRE

TIME IN MINUTES Based upon national averages